Unidad Deportiva Coordinación

Time current curve report


Schneider

Company information

Name :	Unidad Deportiva
Firstname :	Coordinación
Company :	Outenergy
Customer :	Pr.PPAL-Pr.T-1-P.C.Ramales

The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein.
This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications.
It is the duty of any such user or integrator to perform the appropriate and complete risk analysis, evaluation and testing of the products with respect to the relevant specific application or use thereof.
Neither Schneider Electric Industries SAS nor any of its affiliates or subsidiaries shall be responsible or liable for misuse of the information contained herein.

Time current curve

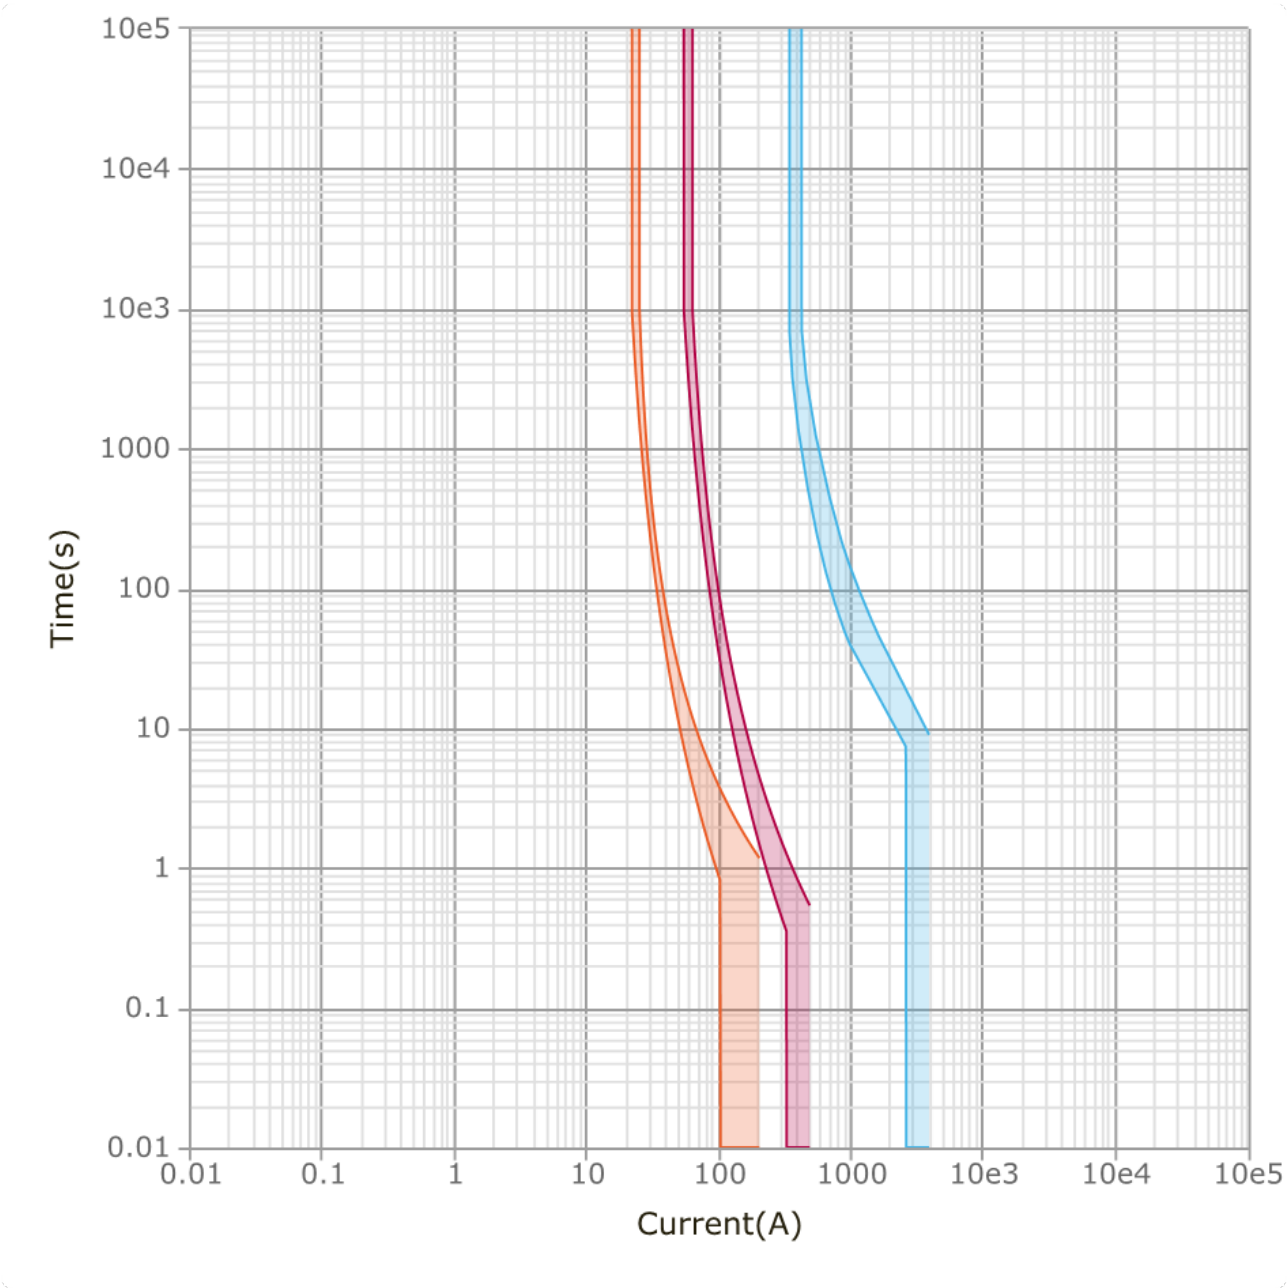

The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein.
This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications.
It is the duty of any such user or integrator to perform the appropriate and complete risk analysis, evaluation and testing of the products with respect to the relevant specific application or use thereof.
Neither Schneider Electric Industries SAS nor any of its affiliates or subsidiaries shall be responsible or liable for misuse of the information contained herein.

	Circuit breaker
Name	CVS400F TM-D - 320
Range	EasyPact CVS
Designation	CVS400F
Circuit breaker rating	400 A
Trip unit	TM-D
Trip unit rating	320 A
Long delay settings	
Ir	320 A
Tr	NA
Short delay settings	
Isd	3200 A
Tsd	NA
Instantaneous tripping	
Ii	NA

	Circuit breaker
Name	xC60 C - 50
Range	Acti9 iC60
Designation	xC60
Circuit breaker rating	50 A
Trip unit	C
Trip unit rating	50 A
Long delay settings	
Ir	50 A
Tr	NA
Short delay settings	
Isd	400 A
Tsd	NA
Instantaneous tripping	
Ii	NA

	Circuit breaker
Name	iK60N C - 20
Range	Acti9 iK60
Designation	iK60N
Circuit breaker rating	20 A
Trip unit	C
Trip unit rating	20 A
Long delay settings	
Ir	20 A
Tr	NA
Short delay settings	
Isd	150 A
Tsd	NA
Instantaneous tripping	
Ii	NA

The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein.
This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications.
It is the duty of any such user or integrator to perform the appropriate and complete risk analysis, evaluation and testing of the products with respect to the relevant specific application or use thereof.
Neither Schneider Electric Industries SAS nor any of its affiliates or subsidiaries shall be responsible or liable for misuse of the information contained herein.